



**2014-2015 Wet Weather WQO Ratios
for S01 Ballona Creek at Sawtelle Blvd.**

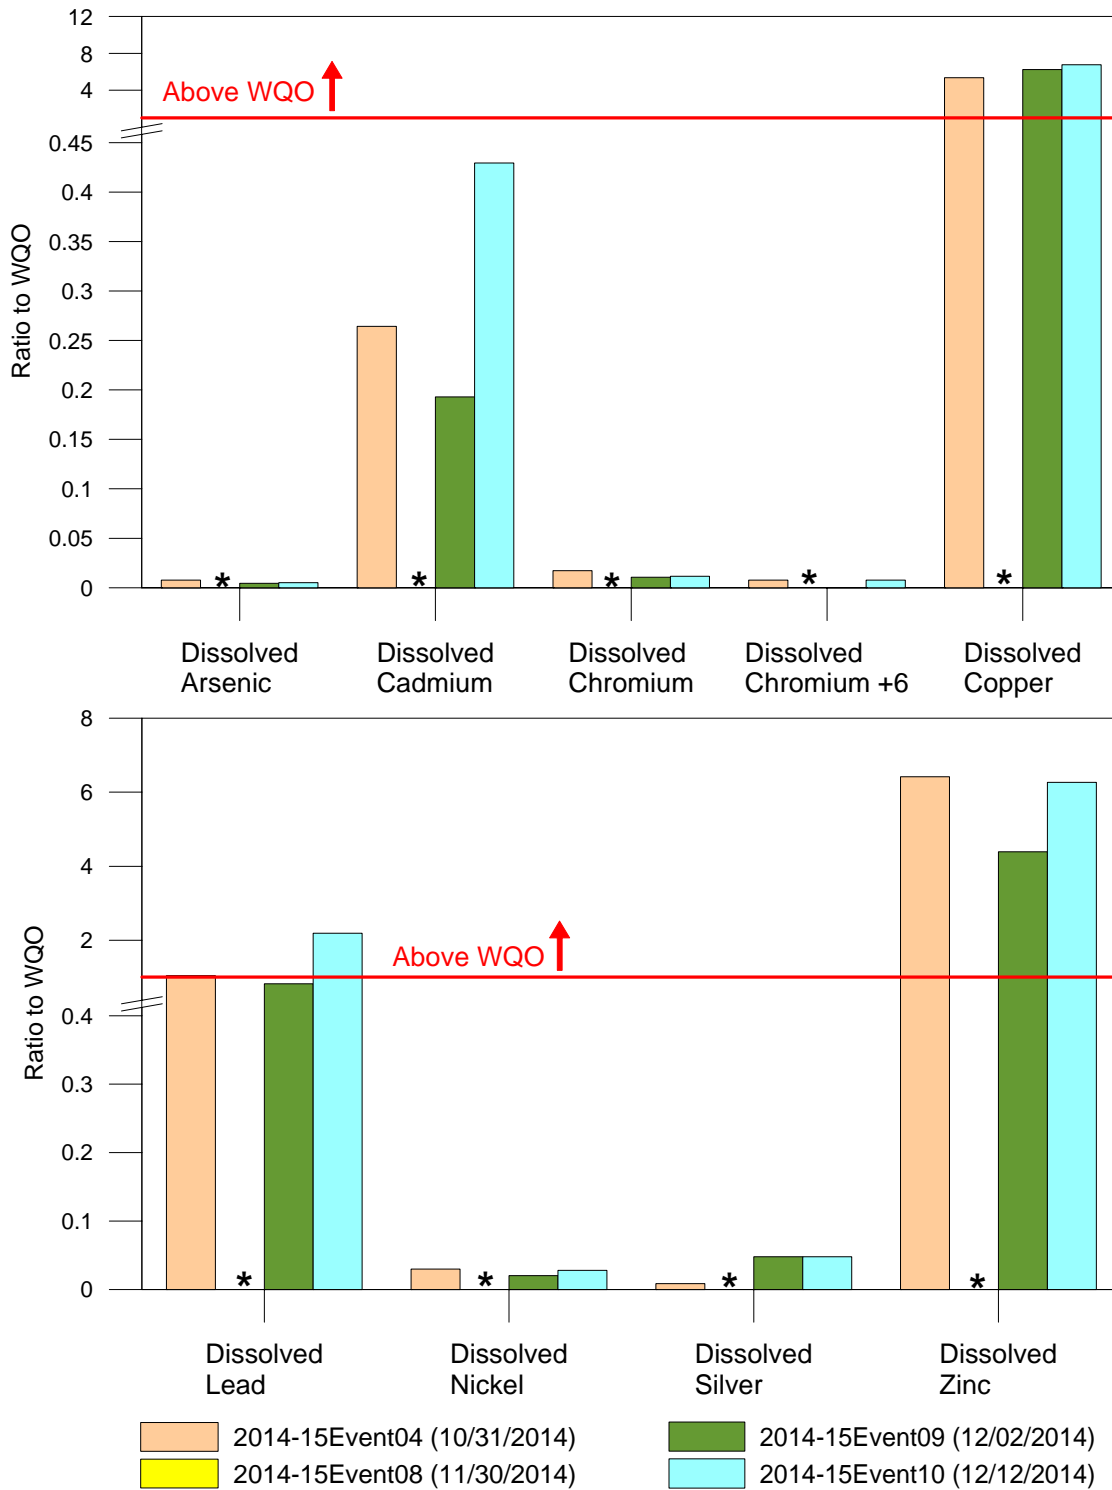

*Samples were not collected for dissolved metals during Event 08.

Figure 4-3.1 S01 Ballona Creek at Sawtelle Blvd Wet Weather Ratio Plots

2014-2015 Wet Weather WQO Ratios for S01 Ballona Creek at Sawtelle Blvd.

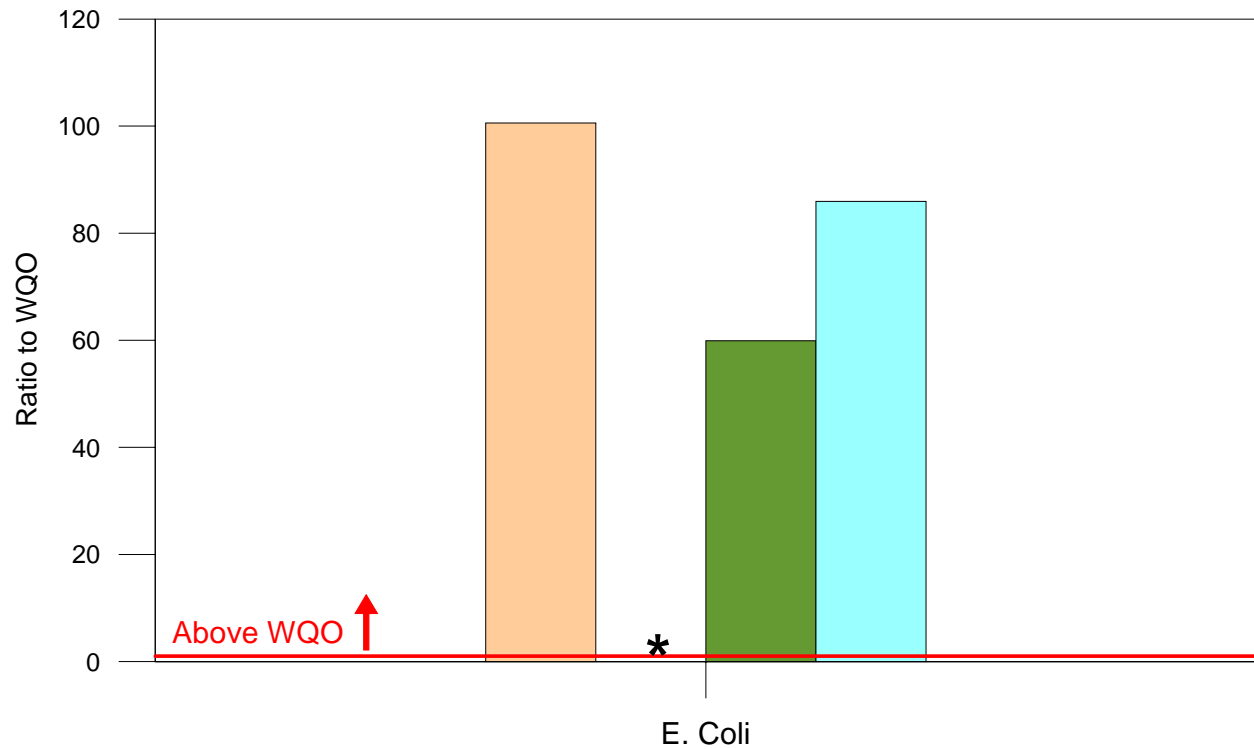

2014-15Event04 (10/31/2014)

2014-15Event08 (11/30/2014)

2014-15Event09 (12/02/2014)[▲]


2014-15Event10 (12/12/2014)[▲]

*Samples were not collected for fecal coliforms during Event 08.

[▲]Not an exceedance of the E. coli water quality objective due to the High Flow Suspension of Recreational Uses (LARWQCB, 2003).

Figure 4-3.1 S01 Ballona Creek at Sawtelle Blvd Wet Weather Ratio Plots

2014-2015 Wet Weather WQO Ratios for S01 Ballona Creek at Sawtelle Blvd.

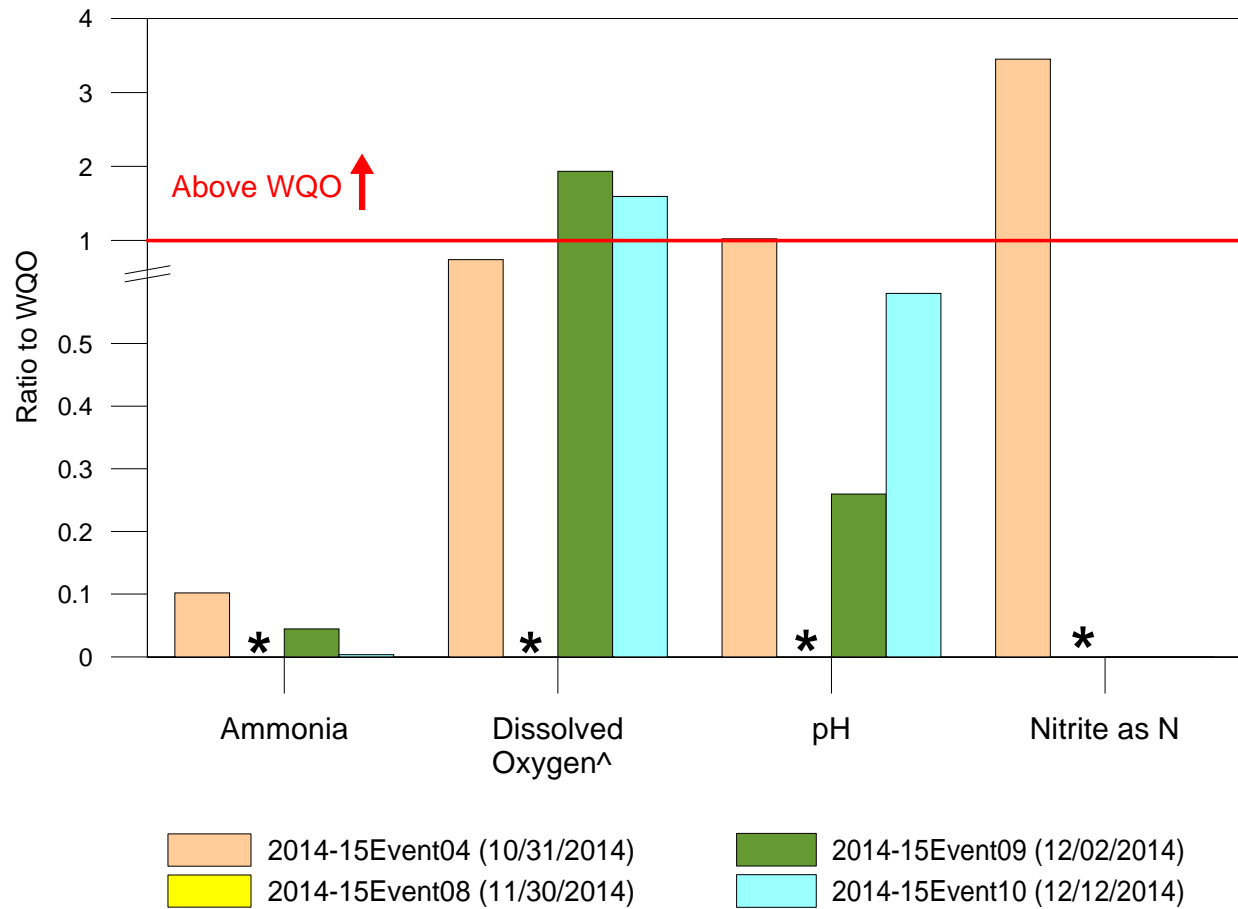

^Dissolved oxygen is an exceedance if ratio to WQO is below 1.

*Samples were not collected for ammonia, dissolved oxygen, pH, or nitrite as N during Event 08.

Figure 4-3.1 S01 Ballona Creek at Sawtelle Blvd Wet Weather Ratio Plots